
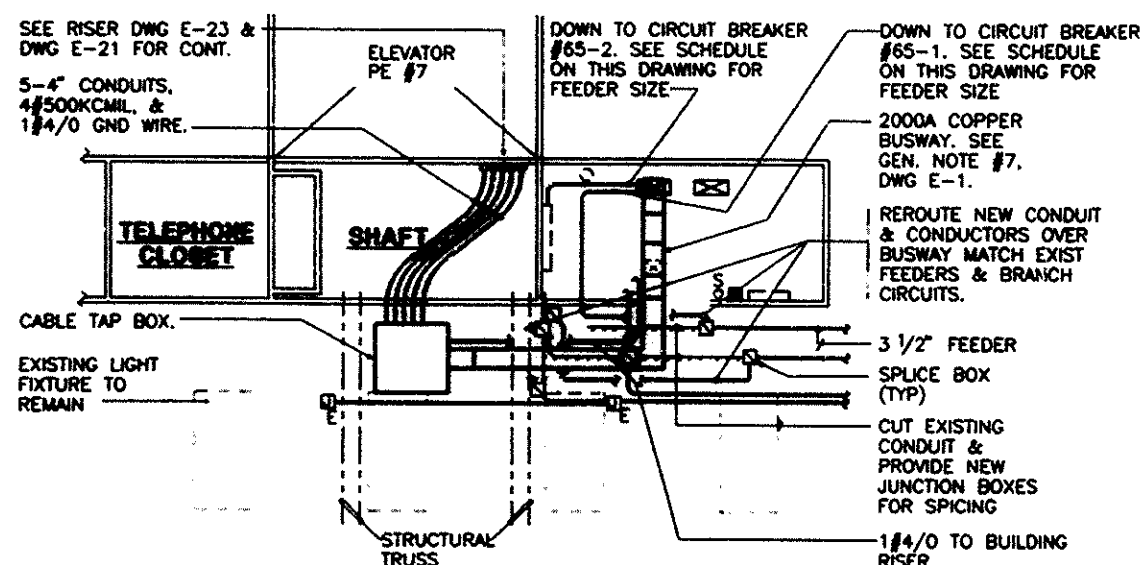
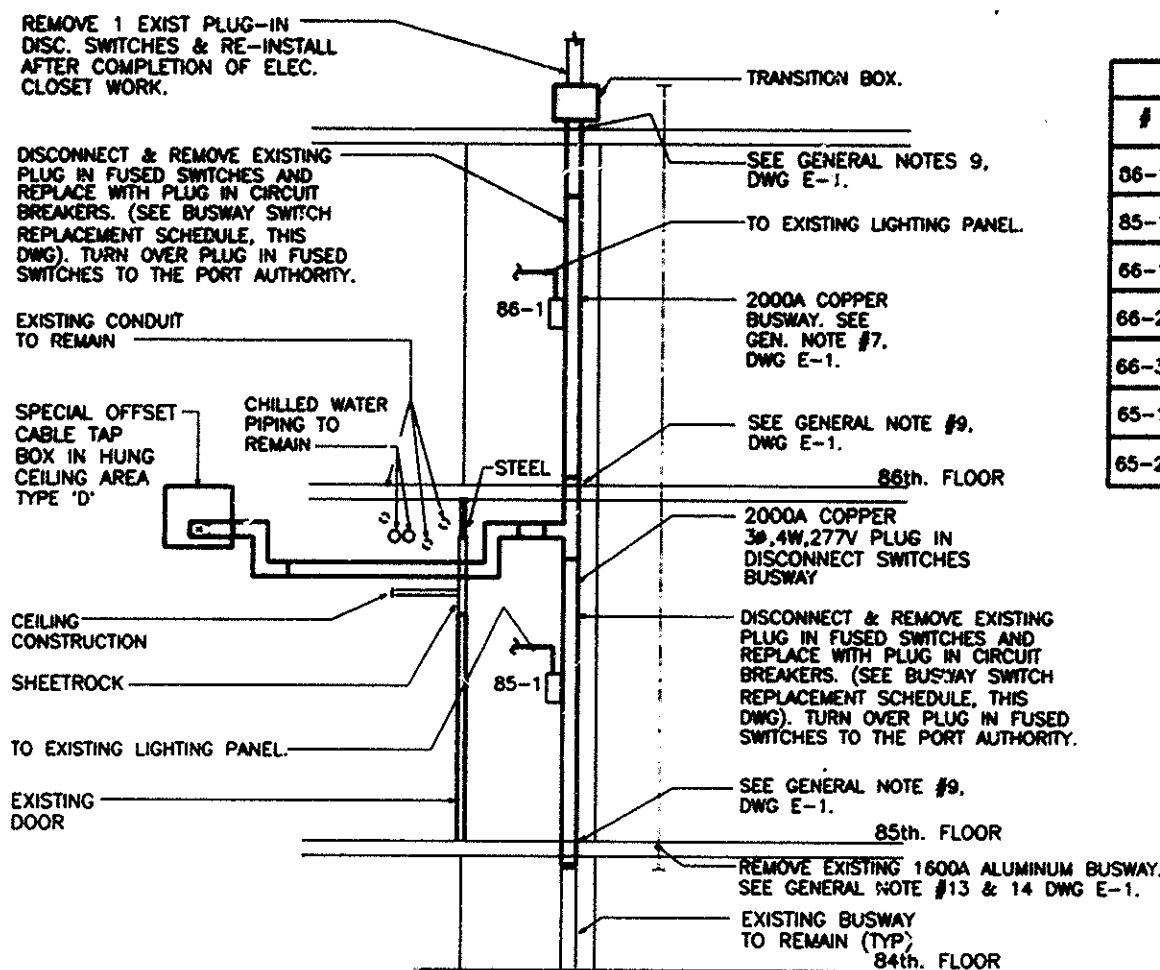


85 EAST PLAN

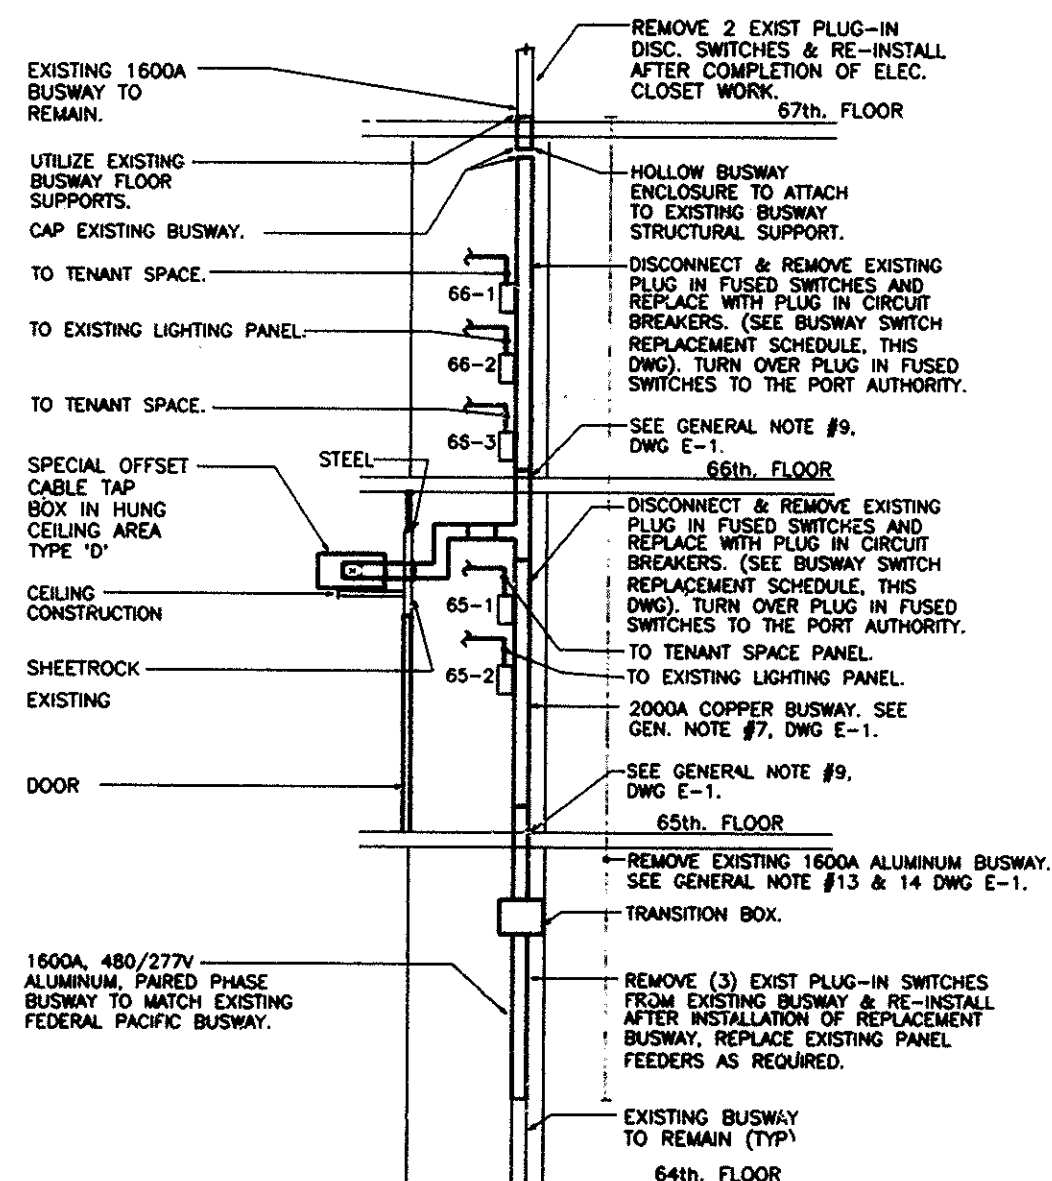


65 EAST PLAN


85th FLOOR SECTION A-A
& PART RISE

65th FLOOR SECTION A-A
& PART RISE

#	EXIST. SW. SIZE	EXIST. FUSE RATING	NEW BREAKER RATING	NEW FEEDER	NEW COT	REMARKS
66-1	200A	125A	225AF/125AT	4#1 CU 1 1/2"		
85-1	200A	125A	225AF/125AT	4#1 CU 1 1/2"		
66-2	200A	200A	225AF/200AT	4#3/0 CU 2"		
66-3	200A	125A	225AF/125AT	4#1 CU 1 1/2"		
65-1	200A	200A	225AF/200AT	4#3/0 CU 2"		
65-2	200A	200A	225AF/200AT	4#3/0 CU 2"		

NOTES:

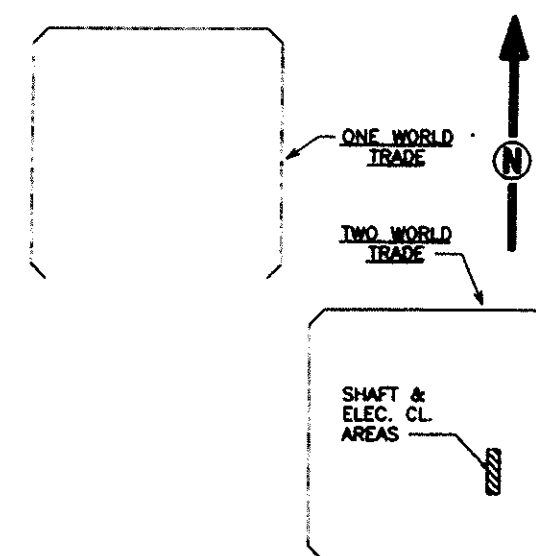- SEE DRAWING E-1 FOR BUSWAY SCHEDULE & GENERAL NOTES.
- INTERCEPT EXISTING PANELBOARD FEEDERS, SERVING TENANT SPACE PANELBOARDS, IN TENANT HUNG CEILING AREA. PROVIDE PULLBOX, FOR SPLICING.



WORK AREA KEY PLAN

Sheet 39 of 41

THE PORT AUTHORITY
OF NY & NJ

Engineering Program Manager

EDWARDS AND ZUCK, P.C.
CONSULTING ENGINEERS
330 West 42nd Street, New York, NY 10036
212-736-3400
© 1992 Edwards and Zuck, P.C.


No. Date Revision Approved

Engineering Department
Design Division

The World Trade
Center
Electrical/HVAC
Upgrade Program

Title
LOW VOLTAGE DISTRIBUTION

TWO WTC
ELECTRICAL

65TH & 85TH FLOOR

EAST SIDE

ELECTRIC CLOSET PART PLAN

This drawing subject to conditions in contract.
All inventions, ideas, designs and methods
herein are reserved to Port Authority and
may not be used without its written consent.

CJ/CADD MW/CADD FJL
Designed by Drawn by Checked by

Date 10/4/93

Scale 1/4" = 1'-0"

Contract Number

Drawing Number

WCT-804.041 E-22